
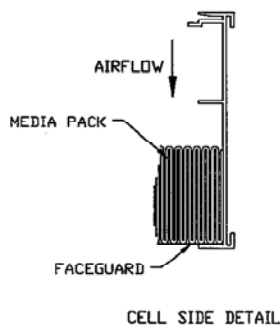


Item Number	Construction Code	Nominal Size (Inches) H x W	Actual Size (Inches) H x W x D	Inlet Collar Diameter (Inches)	Efficiency	Initial Resistance (In. W.G.)	Rated Air Flow (CFM) @ 90 FPM	Media Area (Sq. Ft.)
2999230	CD2424 0L-0N0 750 W3B	24 x 24	23-5/8 x 23-5/8 x 5	10	99.99% @ 0.3 Micron	0.45	306	95
2999228	CD2448 0L-0N0 750 W3B	24 x 48	23-5/8 x 47-5/8 x 5	10	99.99% @ 0.3 Micron	0.45	638	186

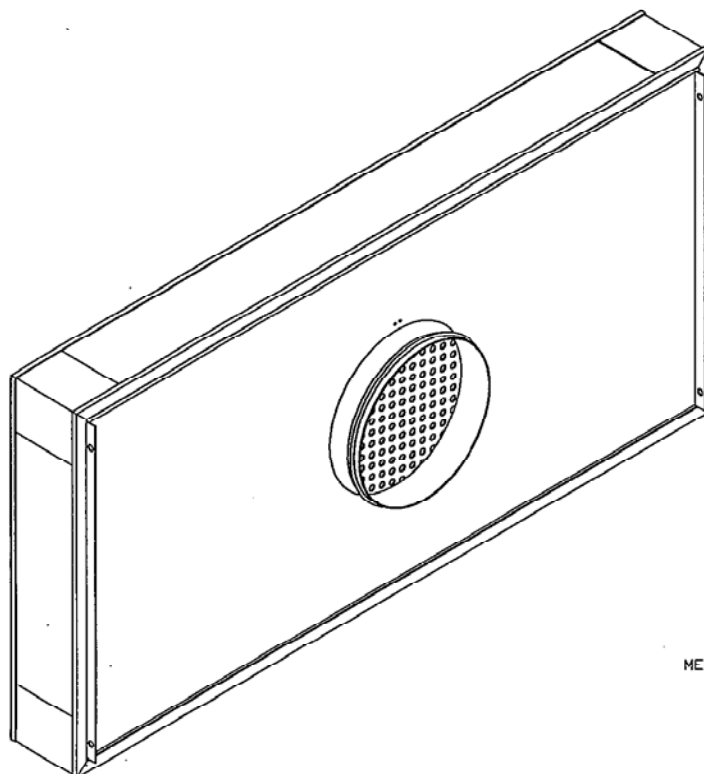

Construction	Code	Description
Standard and Certification	0	HEPA-TEST-RP-CC001.3 per MIL-STD 282
Frame Material	N	Aluminized Extruded Aluminum
Frame Style	0	No Center Port - Fixed Damper
Gasket	7	None
Gasket Location	5	None
Sealant	0	Urethane (180 deg. F)
Hardware	W	White Expanded Metal - Downstream
Acceptance Level	3	99.99% @ 0.3 Micron Scanned
Separators	B	1-5/8" Bead Pack (160 deg. F)

Notes

1. Media: Micro-Glass Fiber / Acrylic Resin Binder
2. Rated Velocity - 90 FPM
3. Recommended Final Resistance: Twice Initial Resistance
(Ex. CD2448 0L-0N0 750 W3B Final Resistance: 0.90" W.G. @620 CFM)
4. Class 2 Filter Per U.L. Standard 900
5. Maximum Operating Temperature (160 deg. F)
6. Shipping Weight:
2 x 2 Module - 20 lb.
2 x 4 Module - 36 lb.

AIRGUARD ONE SOURCE
FOR AIR FILTRATION
PRODUCTS

P.O. Box 32578
Louisville, KY 40232
P: 502-969-2304
F: 502-969-2759

**CONTACT FACTORY TO
VERIFY REVISION LEVEL**

TOLERANCES
UNLESS OTHERWISE SPECIFIED

FRACTIONAL
DECIMAL
ANGLES

ALL DIMENSIONS IN INCHES

DRAWING NAME
MICROPLEAT DUCTED DISPOSABLE CEILING MODULES
10" COLLAR, FOR 1-1/2" T-BAR GRID - FIXED DAMPER

APPROVED BY *KC* SPECIFICATION NO.
MKT-B-00406

SCALE NONE DWG. SIZE A REVISION B

PAGE 1 OF 1
REVISION DATE 08-04-05

CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY AIRGUARD. THE EXPRESSION OF THE INFORMATION CONTAINED HEREIN IS PROTECTED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.